

CHT Prediction of Thermal State of Underground Conductor in Power Distribution Networks

M'hamed Beriache

Laboratory of Rheology and
Mechanics, Department of
Mechanical Engineering, Faculty
of Technology, Hassiba
Benbouali University of Chlef,
Chlef, Algeria
m.beriache@univ-chlef.dz

Sid Ali Koubili

Department of Mechanical
Engineering, Faculty of
Technology, Hassiba Benbouali
University of Chlef, B.P 78C,
Ouled Fares 02180
Chlef, Algeria
koubilisidali.2000@gmail.com

Nor Azwadi Che Sidik

Malaysia-Japan International
Institute of Technology (MJIT),
University Teknologi Malaysia
Kuala Lumpur, Jalan Sultan
Yahya Petra, 54100
Kuala Lumpur, Malaysia
azwadi@mail.fkm.utm.my

Meziane Nasreddine

Department of Hydraulics,
Faculty of Civil Engineering and
Architecture,
Hassiba Benbouali University of
Chlef, B.P 78C, Ouled Fares
Chlef, Algeria
meznasr@gmail.com

Belarbi Abdelillah Abed

Department of Mechanical
Engineering, Faculty of
Technology, Hassiba Benbouali
University of Chlef, B.P 78C,
Ouled Fares 02180
Chlef, Algeria
a.belarbi@univ-chlef.dz

Mokhtar Saïdia Leila

Department of Mechanical
Engineering, Faculty of
Technology, Hassiba Benbouali
University of Chlef, B.P 78C,
Ouled Fares 02180
Chlef, Algeria
lmokhtarsaidia@gmail.com

Abstract- This research aims at a deeper understanding of the steady-state thermal behavior of underground cables using Computational Heat Transfer (CHT) techniques modeling. The results concern the thermal study of 33 kV single and multiple copper conductors with a nominal conductor cross-section of 615 mm² buried in the ground for a single cable, two cables and for three cables in horizontal position. The most unfavorable summer conditions, the burial depth as well as the physical properties of the soil as a function of the moisture content, are studied. The operating current of the conductors is taken 940 A. The results show that the temperature of the cables decreases with the burial depth, a compromise temperature/cost of installation corresponds to 80 cm of burial depth. Further, the maximum temperature of a single cable buried in the ground is considerably lower than that allowed (363 K) for a good use, namely 313 K in summer conditions, so there is a considerable margin to increase its ampacity, also the temperature decrease with increase of water content of the soil surrounding the cable of approximately 2 to 5 degrees. The results obtained are in good agreement with those of the literature.

Keywords—underground cables, ampacity, thermal state, power distribution networks, CHT modeling

I. INTRODUCTION

Modern methods of power transmission and distribution include extensive use of underground and underground power cables. The problem of optimizing the electrical cables and their exploitation for good performance has become of great importance, especially with the conditions of today, which require a high quality of service and the rationalization of the expenses. On the other hand, operators of electricity distribution networks in Algeria face a number of challenges, notably due to the increased growth of the load and the


environmental demands of the population. Therefore, it has become very important to try to increase the exploitation of the existing infrastructure of the power grids to overcome these challenges. A good arrangement of the cable configuration, thus the working parameters under different loads, climatic conditions and soil properties, can lead to improved cable performance. In this vision, computational heat transfer techniques can be used to predict numerically the thermal state of electrical buried cables in the ground under different configurations and working parameters. The numerical resolution of these problems for a precise estimate of the thermal state of the main components of the electricity distribution network will be the main and new contribution to academic and industrial knowledge in the field of very high voltage underground electric cables. This can be used to assist specialists in performing the good cable configuration with the right parameters. The use of underground cables in Algeria has grown significantly over past two decades as a result of urban expansion and increased infrastructure activities. However, the weather conditions in Algeria are very severe especially in summer where the ambient temperature sometimes exceeds 50°C and the water content of the soil is very low. It adds to that the strong consumption of electrical energy by the population in this very hot period of the year. Under such conditions, current carrying capacity of the cable is highly influenced. The accuracy of methods for estimating the thermal state of underground conductors is crucial, especially in cases where the network is operating under high load conditions. In most previous researches, the effects of various cable configuration, operation, design, soil and environmental parameters on the ampacity of the cable have classically been studied [1-6]. In this work, a new model based on the Computational Heat Transfer (CHT) technique of the electric cable taken in its real working environment is proposed. The main objective of the work is to predict numerically the

thermal state of electrical cables buried in the ground under different configurations and working under a current of 940 amperes, taking into account the physical properties of the soil for a range of content values in moisture. Firstly, we want to have the correct laying configuration of the cables following which the operating temperature of the cable is the lowest, secondly, to do the same thing when the cables are housed in HDPE ducts for possible extensions of the cable network and reasons for maintenance especially. We are looking for the temperature and the limit current of the cables in order to better exploit the existing electricity network without any additional modifications with the support of the different factors of the problem. The results of the temperature field obtained are compared with the temperatures recommended by the standards in the field.

II. PROBLEM MODELING

A. Geometry

The physical design of the conductor is presented in Fig. 2.2. The real geometry of the conductor is complex and contains the following components: the copper conductor core made of strands; the conductor screen (polyethylene); insulation (cross-linked polyethylene); the insulation screen (polyethylene); the copper screen; the binder tape (polyethylene) and oversheath (medium density polyethylene). For purpose of creating, the computational mesh the real geometry of the conductor was simplified (to reduce computational time) and presented as a combination of four co-axial cylinders. The outer diameter of the copper conductor and the oversheath is 28.3 and 60.4 mm, respectively.



1. Copper conductor; 2. Conductor screen; 3. Insulation; 4. Copper screen; 5. Oversheath

Fig. 2.1. Geometry model of the cable

The dimensions of the simplified model are as follows: the diameter of copper cable with nominal area of conductor of 630 mm² is 28.3 mm; the thickness of insulation is 8 mm; the thickness of the copper wire screen is 1 mm and the thickness of oversheath is 2.7 mm,

B. Computational Domain

Figure 2.2 presents the computational domain used for the numerical modelling of the thermal state of a single copper cable buried in the soil. In this domain, the cable is placed at the centre of the soil the domain. These dimensions (in mm) of the domain are large enough to produce size independent solution.

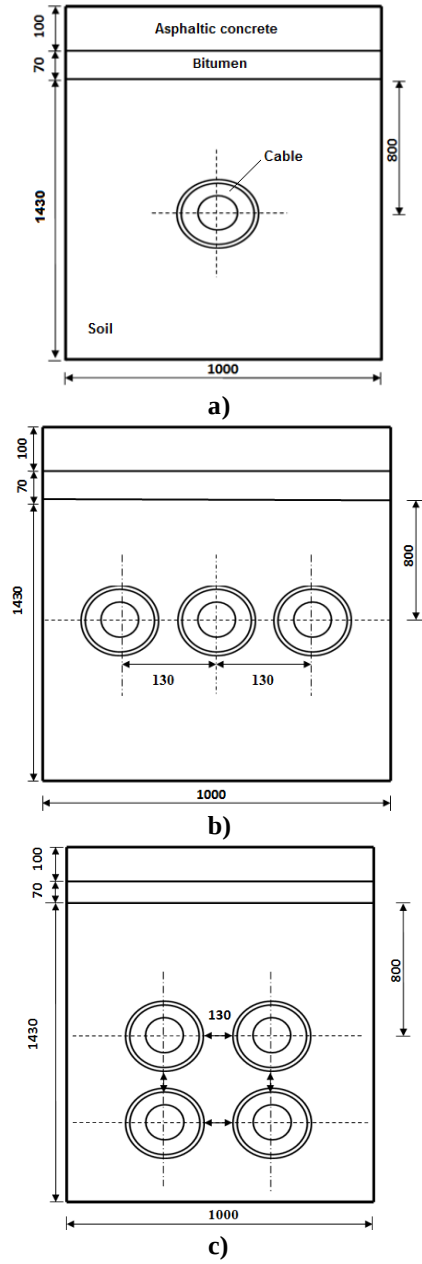


Fig. 2.2 Computational domain for numerical study
a) of single copper cable buried in soil, b) three buried cable,
c) four buried cable

As previously, mesh refinement tests were conducted in order to ensure that the solutions are not mesh dependent.

C. Grid of Computational Domain

The choice of mesh is an essential point in the accuracy, we use the Tgrid-Map element that is triangular element and well suited for round shapes like cable case, (Fig.2.3).

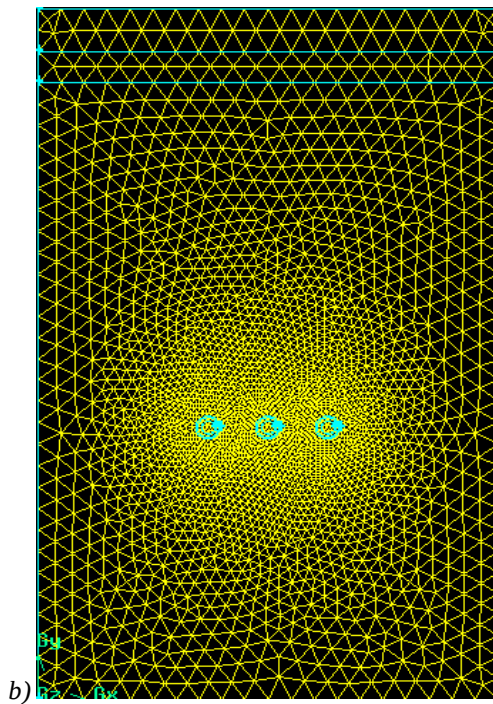
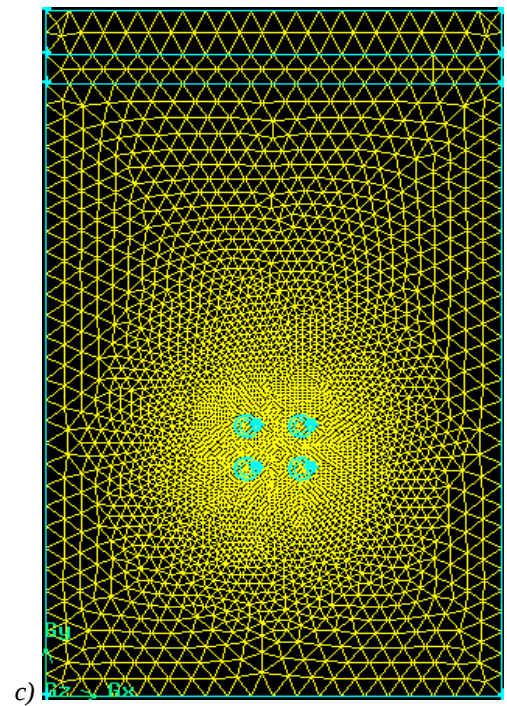
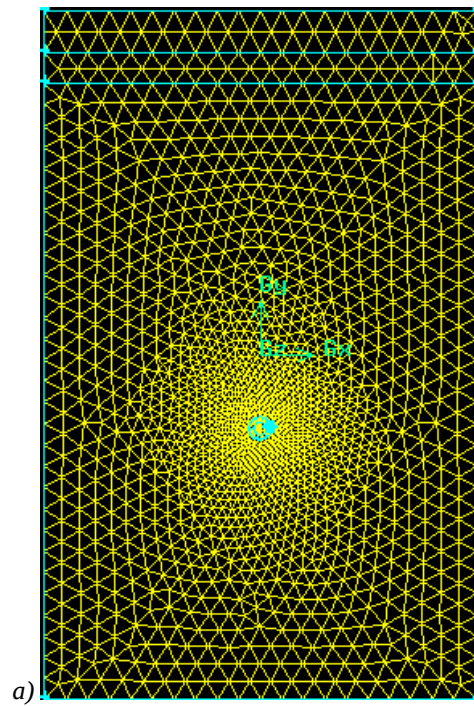


Fig. 2.3 Grid of computational domain
a) single cable buried in soil, b) three buried cable, c) four buried cable

III. DATA AND ASSUMPTIONS FOR CALCULATIONS

Soil is considered as a solid medium and not as a porous substance. In summer, the soil was assumed to dry soil. The thermo-physical properties of the cable (XPLE BS7078) [7] constituting our model are summarized in Table 2.1.

Table 2.1 Thermo-physical properties for components of the cable [7]

Components of the cable	Density kg/m^3	Heat capacity J/kg K	Thermal conductivity W/m.K
Copper conductor	8978	381	387.6
Conductor screen (PVC)	1300	1330	0.182
Insulation	950	2300 @ 293K 3750 @ 353K	0.333
Copper screen	8900	385	370.4
Oversheath	1600	1500	0.25

Table 2.2 Thermo-physical properties for different types of physical domain [7]

Type of soil	Density, kg/m^3	Heat capacity, J/kg K	Thermal conductivity, W/m.K
Asphaltic concrete	2350	870	2.10
Bitumen	2350	870	1.90
Dry soil	1400	800	0.408

According to Electrical Standards P17 [8] for the summer conditions the soil and ambient temperatures are of 293 and 298 K, respectively [9]. The summer conditions are characterized by a low moisture content. The thermal rating for the 630 mm^2 cable in the flat formation in summer

conditions is 940 A, which corresponds to a heat source, q , of $14200,7 \text{ W/m}^3$ [10], calculated as Joule losses by the following relation.

$$q = (I^2 \cdot R) / A \quad (1)$$

Where R is the AC resistance of the copper conductor (Ω/m); A is the cross sectional area of the conductor (mm^2) and I is current in the cable (A). According to the BS 6622-1991 [8] the AC resistance of the copper is $R = 0.0405 \text{ } \Omega/\text{km}$ at 363 K. Accordingly, in all further simulations of the thermal state of underground cables the temperature at the top and at the bottom of the computational domain was set to be uniform and constant at the 298 K and 293 K level respectively in summer conditions. Additionally, a zero heat flux boundary condition was set on the left and right sides of the computational domain.

IV. RESULTS OF NUMERICAL SIMULATIONS

A. Grid independancy test

The calculation time and the accuracy of the result are directly related to the quality of the mesh. In this study, we tested three meshes of increasing quality (1038, 3083, 241396 nodes). From the results obtained in the validation phase of the proposed numerical model (Fig. 5.1). We opted for the mesh of 3083 nodes. This mesh ensures a good compromise between the quality of the mesh and the computation time and the precision of the sought solution.

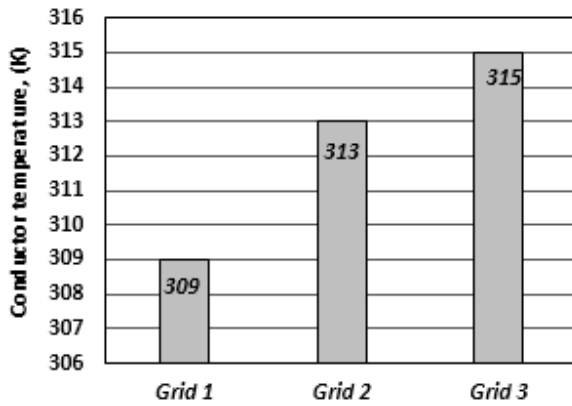


Fig. 5.1 Conductor temperature versus mesh

B. Effect of the burial depth

In aim to find the right depth of burial cable, several tests simulations were conducted. The results are presented in Fig.5.2. From the results, it can be seen that the conductor temperature decreases with depth. Our choice was based on the 80 cm burial depth for simple reasons; it provides the lowest driver temperature among those tested, so it is an economic compromise.

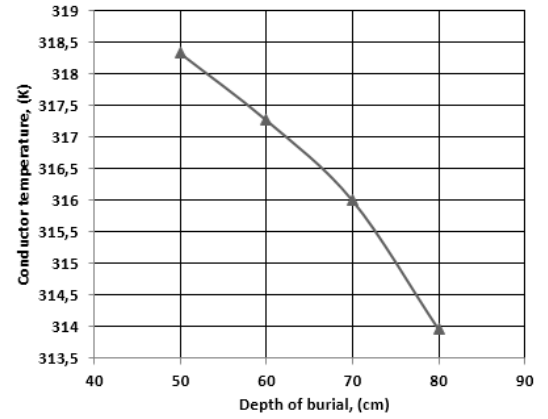


Fig. 5.2 Conductor temperature based on depth of burial

C. Effect of current on the temperature of the cable

Figure 5.3 presents the variation of temperature as a function of the current resulting from the simulation tests. It can be seen that the temperature of the cable increases proportionally with the operating current. This result is in the same trend as that obtained by Moya et al. [11].

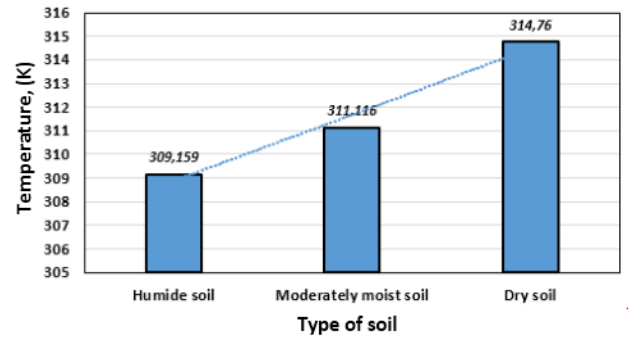


Fig. 5.3 Effect of current on cable temperature

D. Conductor temperature variation as a function of current

Figure 5.4 presents the variation of temperature as a function of the current resulting from the simulation tests. It can be seen that the temperature of the cable increases proportionally with the operating current. This result is in the same trend as that obtained by Moya et al. [11].

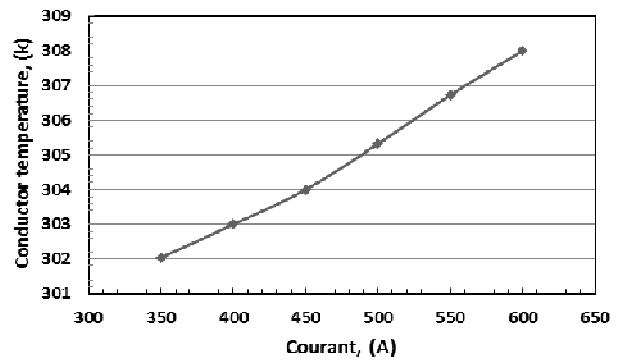


Fig. 5.4 Conductor temperature variation as a function of operating current

E. Temperature distribution in a single buried cable system

Figure 5.5. shows the temperature distribution at the cable as well as its vicinity for a working current of 940 A under summer conditions. As expected, the temperature distribution is symmetrical with reference to a vertical plane passing through the axis of the cable. In summer conditions, there is a low temperature gradient in the soil layers above the cable; this gradient is greater in the soil layer below the cable. This says that the temperature propagates from the cable to the roadway.

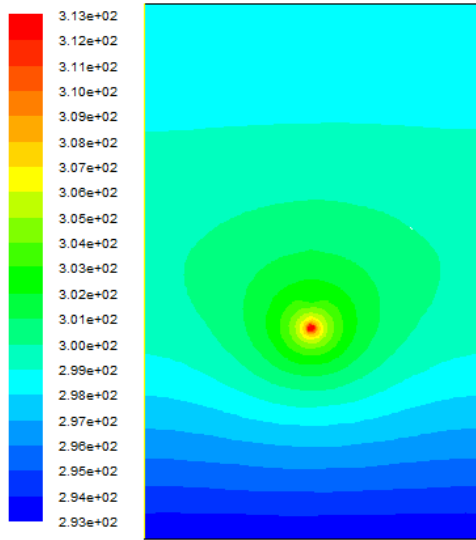


Fig. 5.5. Contours of temperature in a system of a single buried cable

For summer conditions and a 940 A working current, the conductor's temperature rise is 313 K. This temperature is below the recommended limits [11]. Figure 5.6 shows the average temperature profile in the horizontal plane passing through the axis of the cable.

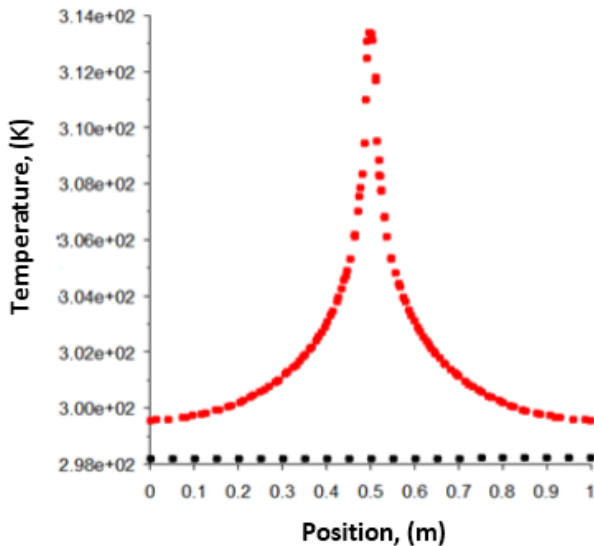


Fig. 5.6. Average temperature profile at the cable and the roadway

There is a peak temperature at the cable (heat source) which is very normal, the temperature decreases as soon as you move away from the cable symmetrically. On the other hand, the temperature in the level of the pavement does not register a net change, this being said to the damping effect of the soil on the propagation of the temperature.

F. Distribution of temperature in a system of three buried cables

Figure 5.7 shows the distribution of temperature around a system of three buried cables in dry soil carrying 940 A in summer conditions. It is observed that the temperature of the central cable reaches 342.19 K (Fig.5.8), this temperature is higher than that recorded for the case of a single cable under the same functioning conditions. This increase is due to the accumulation of heat caused by the two cables located on either side of the central cable. Despite this rise in temperature, the cables remain operating in the recommended standards. This result is in the same trend as that obtained by Irina Makhkamova [10].

Figure 5.8 shows the average temperature profile in the horizontal plane passing through the axis of the three cables. There are three temperature peaks above the cables (heat source), the peak of the middle cable is higher than the others, this is due to the extra heat gain caused by the neighboring cables. The temperature decreases as soon as one moves away from the cable symmetrically. On the other hand, the pavement temperature (≈ 300 K) shows a net increase compared to that recorded for a single cable.

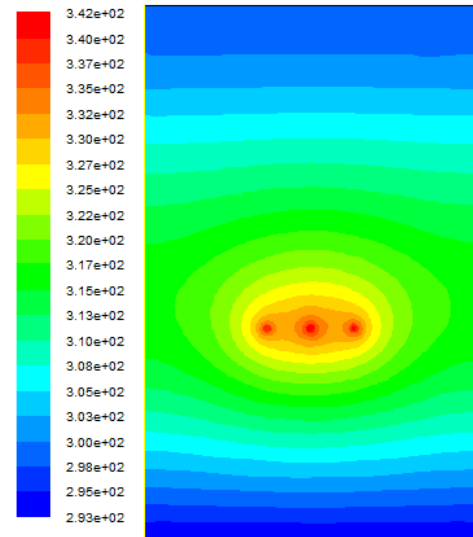


Fig. 5.7 Contours of temperature in a system of three buried cable

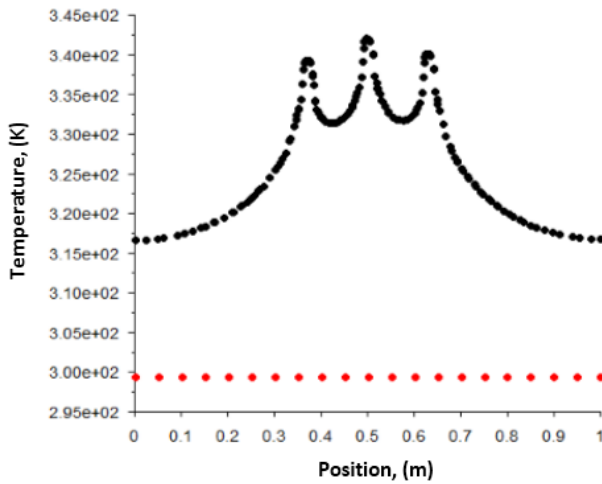


Figure 5.8 Average temperature profile at the three cable and the roadway

G. Distribution of temperature in a system of four buried cables

In this system consisting of four cables, two cables are active; the other two are emergency cables. This type of system is used in long and high power lines. Two alternative cable placements may occur; two piled cables or two cables in line position. Fig. 5.9 (a) represents the distribution of the temperature in a system of two superimposed cables in operation carrying 940 A under severe climatic conditions. It is observed that the distribution of the temperature is non symmetric this is due to the barrier (resistance) represented by the two other spare cables. The maximum temperature recorded at the operational cable levels is 325 K. This temperature complies with the recommended restrictions.

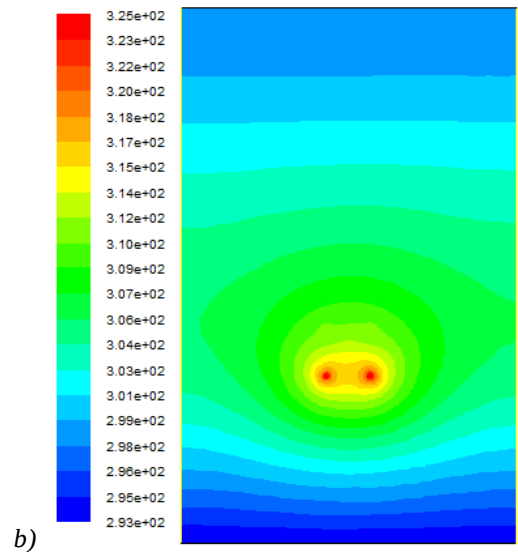
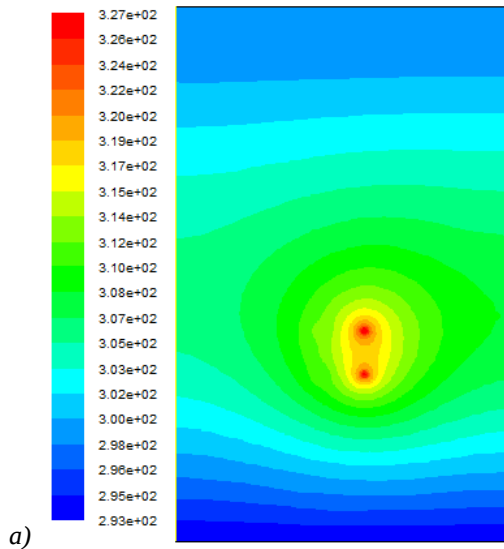


Fig. 5.9 Temperature contours in a system of four buried cables
(a) two piled cables, (b) two cables in line

For the same system with four buried cables, Fig. 5.9 (b) presents the case of two operational cables in line. In this configuration, the temperature distribution is symmetrical with respect to a vertical axis passing through the middle of the cables. It should be noted that this configuration has a lower cable temperature (325 K) than that of piled cable configuration (327 K). In conclusion, the configuration of two cables in line is thermally recommended than that of two superimposed cables.

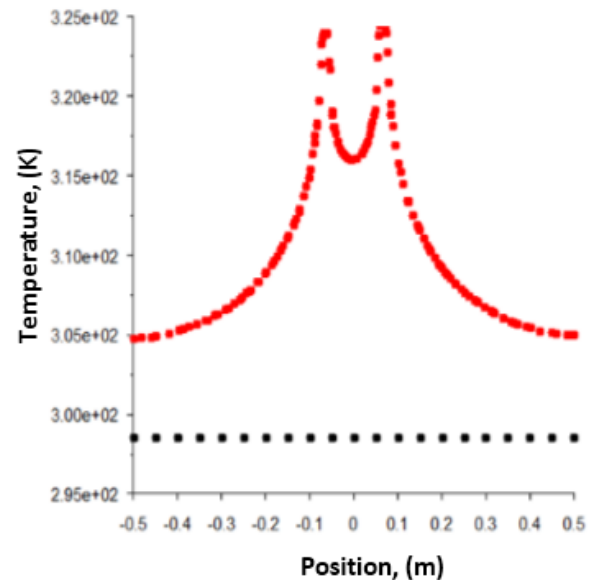


Fig. 5.10 Average temperature profile at the cables and the roadway

Figure 5.10 shows the average temperature profile in the horizontal plane passing through the axis of the two cables. There are two temperature peaks above the cables (heat source), these two peaks are interspersed by a temperature

gradient decreasing symmetrically between the two peaks. This is due to the gap separating the two cables. On the other hand, the pavement temperature (299 K) shows a slight decrease compared to the one recorded for the three cables, which is very physically acceptable.

H. Effect of solar radiation

View the intensity of solar radiation in summer in our country. Examination of its possible effect on our model of electric cable buried in the ground is considered essential. Figure 5.11 shows the distribution of the temperature in the cable and its vicinity, for a working current of 940 A with summer condition with solar radiation support. As expected, the temperature distribution is symmetrical with reference to a vertical plane passing through the axis of the cable.

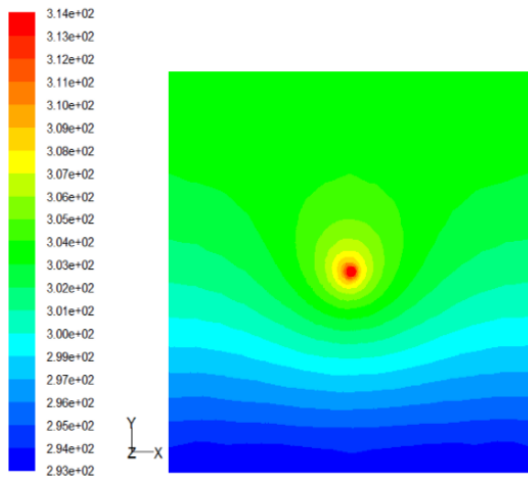


Fig. 5.11 Temperature contours of a cable under solar radiation

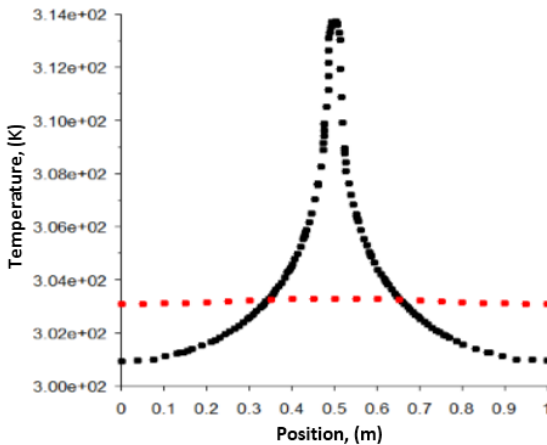


Figure 5.12 Temperature profile of one buried cable and the roadway under solar radiation

The results show that the temperature of the cable is 315 K and that of the roadway is 303 K. We conclude that the radiation effect on the cable is unimportant, although it significantly affects the ground surface. This conclusion is in good agreement with that obtained by Miller [12]. Figure 5.12 shows the average temperature profile in the horizontal plane

passing through the axis of the cable. There is a peak temperature at the cable (heat source) which is very normal; the temperature decreases as soon as you move away from the cable symmetrically. On the other hand, the temperature in the pavement level shows a net change compared to the case without radiation.

V. CONCLUSIONS

The numerical results obtained in this work on the thermal exchanges around underground cables system in the most unfavorable working conditions make it possible to draw the following conclusions:

- The temperature of the conductor decreases with the cable depth, based on several numerical tests; it has been found that the best depth of burial is 80 cm.
- For a single buried cable operating under 940 A current in summer conditions, the maximum predicted conductor temperature is well below the recommended restrictions, so there is considerable potential for increasing its ability to carry more amperage.
- The thermal state of three underground cables laid horizontally under summer conditions is very close to the safety limit, so there is no possibility of increasing the ampacity of these cables unless the distance between the cables is increased interlocking between the cables.
- The maximum conductor temperature is approximately 327 and 325 K in summer conditions for two cables buried in vertical and horizontal forms respectively. Thermally, this means that the best landfill position is the horizontal form.
- The temperature of the cable working in full electric charge (940 A) placed in a cavity buried in the ground reaches 366 K. This exceeds the recommended restrictions. In this case, it is proposed to reduce the amperage up to 900 A so that the cable can operate within the safety limits.
- The temperature of cables buried in the ground is inversely proportional to the soil moisture. So adding water to a porous material drastically decreases its thermal resistance.
- The temperature of the cable increases proportionally with the increase of the operating current.
- The results also showed that the radiation effect on cable temperature is negligible, although it significantly affects the ground surface.

The analysis of the results of the CHT simulations shows that this numerical technique offers a good accuracy in the prediction of thermal transfer around a system of permanent high voltage underground cables and can be used in the analysis and the management of transports and distribution of electrical energy. Finally, the application of CHT techniques allows the calculation and analysis of heat transfer in underground electrical cable systems.

REFERENCES

- [1] Neher, J. H. and McGrath, M. H.1957. The calculation of the Temperature Rise and Load Capability of Cable Systems. MEE Transactions, 76(10):752-772.

- [2] Sellers, S.M. and Black, W. Z. 1996. Refinements to the Neher-McGrath Model for Calculating the Ampacity of Underground Cables. *IEEE Transactions on Power Delivery* 11:12-30.
- [3] Rosch, S.J. 1938. The Current-Carrying Capacity of Rubber-Insulated Conductors. *AIEE Transactions*, 57(3):155-167.
- [4] A.A. Al-Ohaly, Performance of underground power cables under extreme soil and environmental conditions. *Kuwait J. Sci. Eng.* 30(1) 2003.
- [5] Al-Saud, M.S., El-Kady, M.A., & Findlay, R.D. 2007. A new approach to underground cable performance assessment. *Electrical Power Systems Research*, DOI:10.1016/j.epsr.2007.06.010.
- [6] Black, W. Z., Brown K. W. and Harshe B.L. 1999. Ampacity of cables in trays surrounded with fire barrier material. *IEEE Transactions on Power Delivery*, 14(1):8-17.
- [7] King, S.Y. and Halfter, M.A.1982. *Underground power cables*. London and New York, Longman, 185 pages.
- [8] P17 Part3. Current Rating for distribution cables: Ratings for 11kV and 33 kV cables having extruded insulation. 2004. Issue 1.
- [9] Energy Networks Association. Moore, G.F. (Editor), *Electric Cables Handbook/ BICC Cables*, 2004 Third Edition, Blackwell Science.
- [10] Moya, R.E.S., Prata A.T. and Cunha Neto J. A.B. 1999. Experimental analysis of unsteady heat and moisture transfer around a heated cylinder buried into a porous medium. *International Journal of Heat and Mass* 42:2187-2198.
- [11] Makhkamova, Irina (2011). *Numerical Investigations of the Thermal State of Overhead Lines and Underground Cables in Distribution Networks*, Durham theses, Durham University.
- [12] Millar, R.J. and Lehtonen, M. 2005. Real-time transient temperature computation of power cables including moisture migration modelling. *The 15th PSCC, Liege*, 22-26 August 2005, 8 pages